




NOTES
 1. STRING CONDUCTORS SHALL BE ATTACHED TO TRACKER FRAME USING DEL CITY GALVANIZED STEEL LOOM CLAMPS. CLAMPS AND SHALL BE SIZED TO ACCOMMODATE RTD CABLES, WHERE INSTALLED.

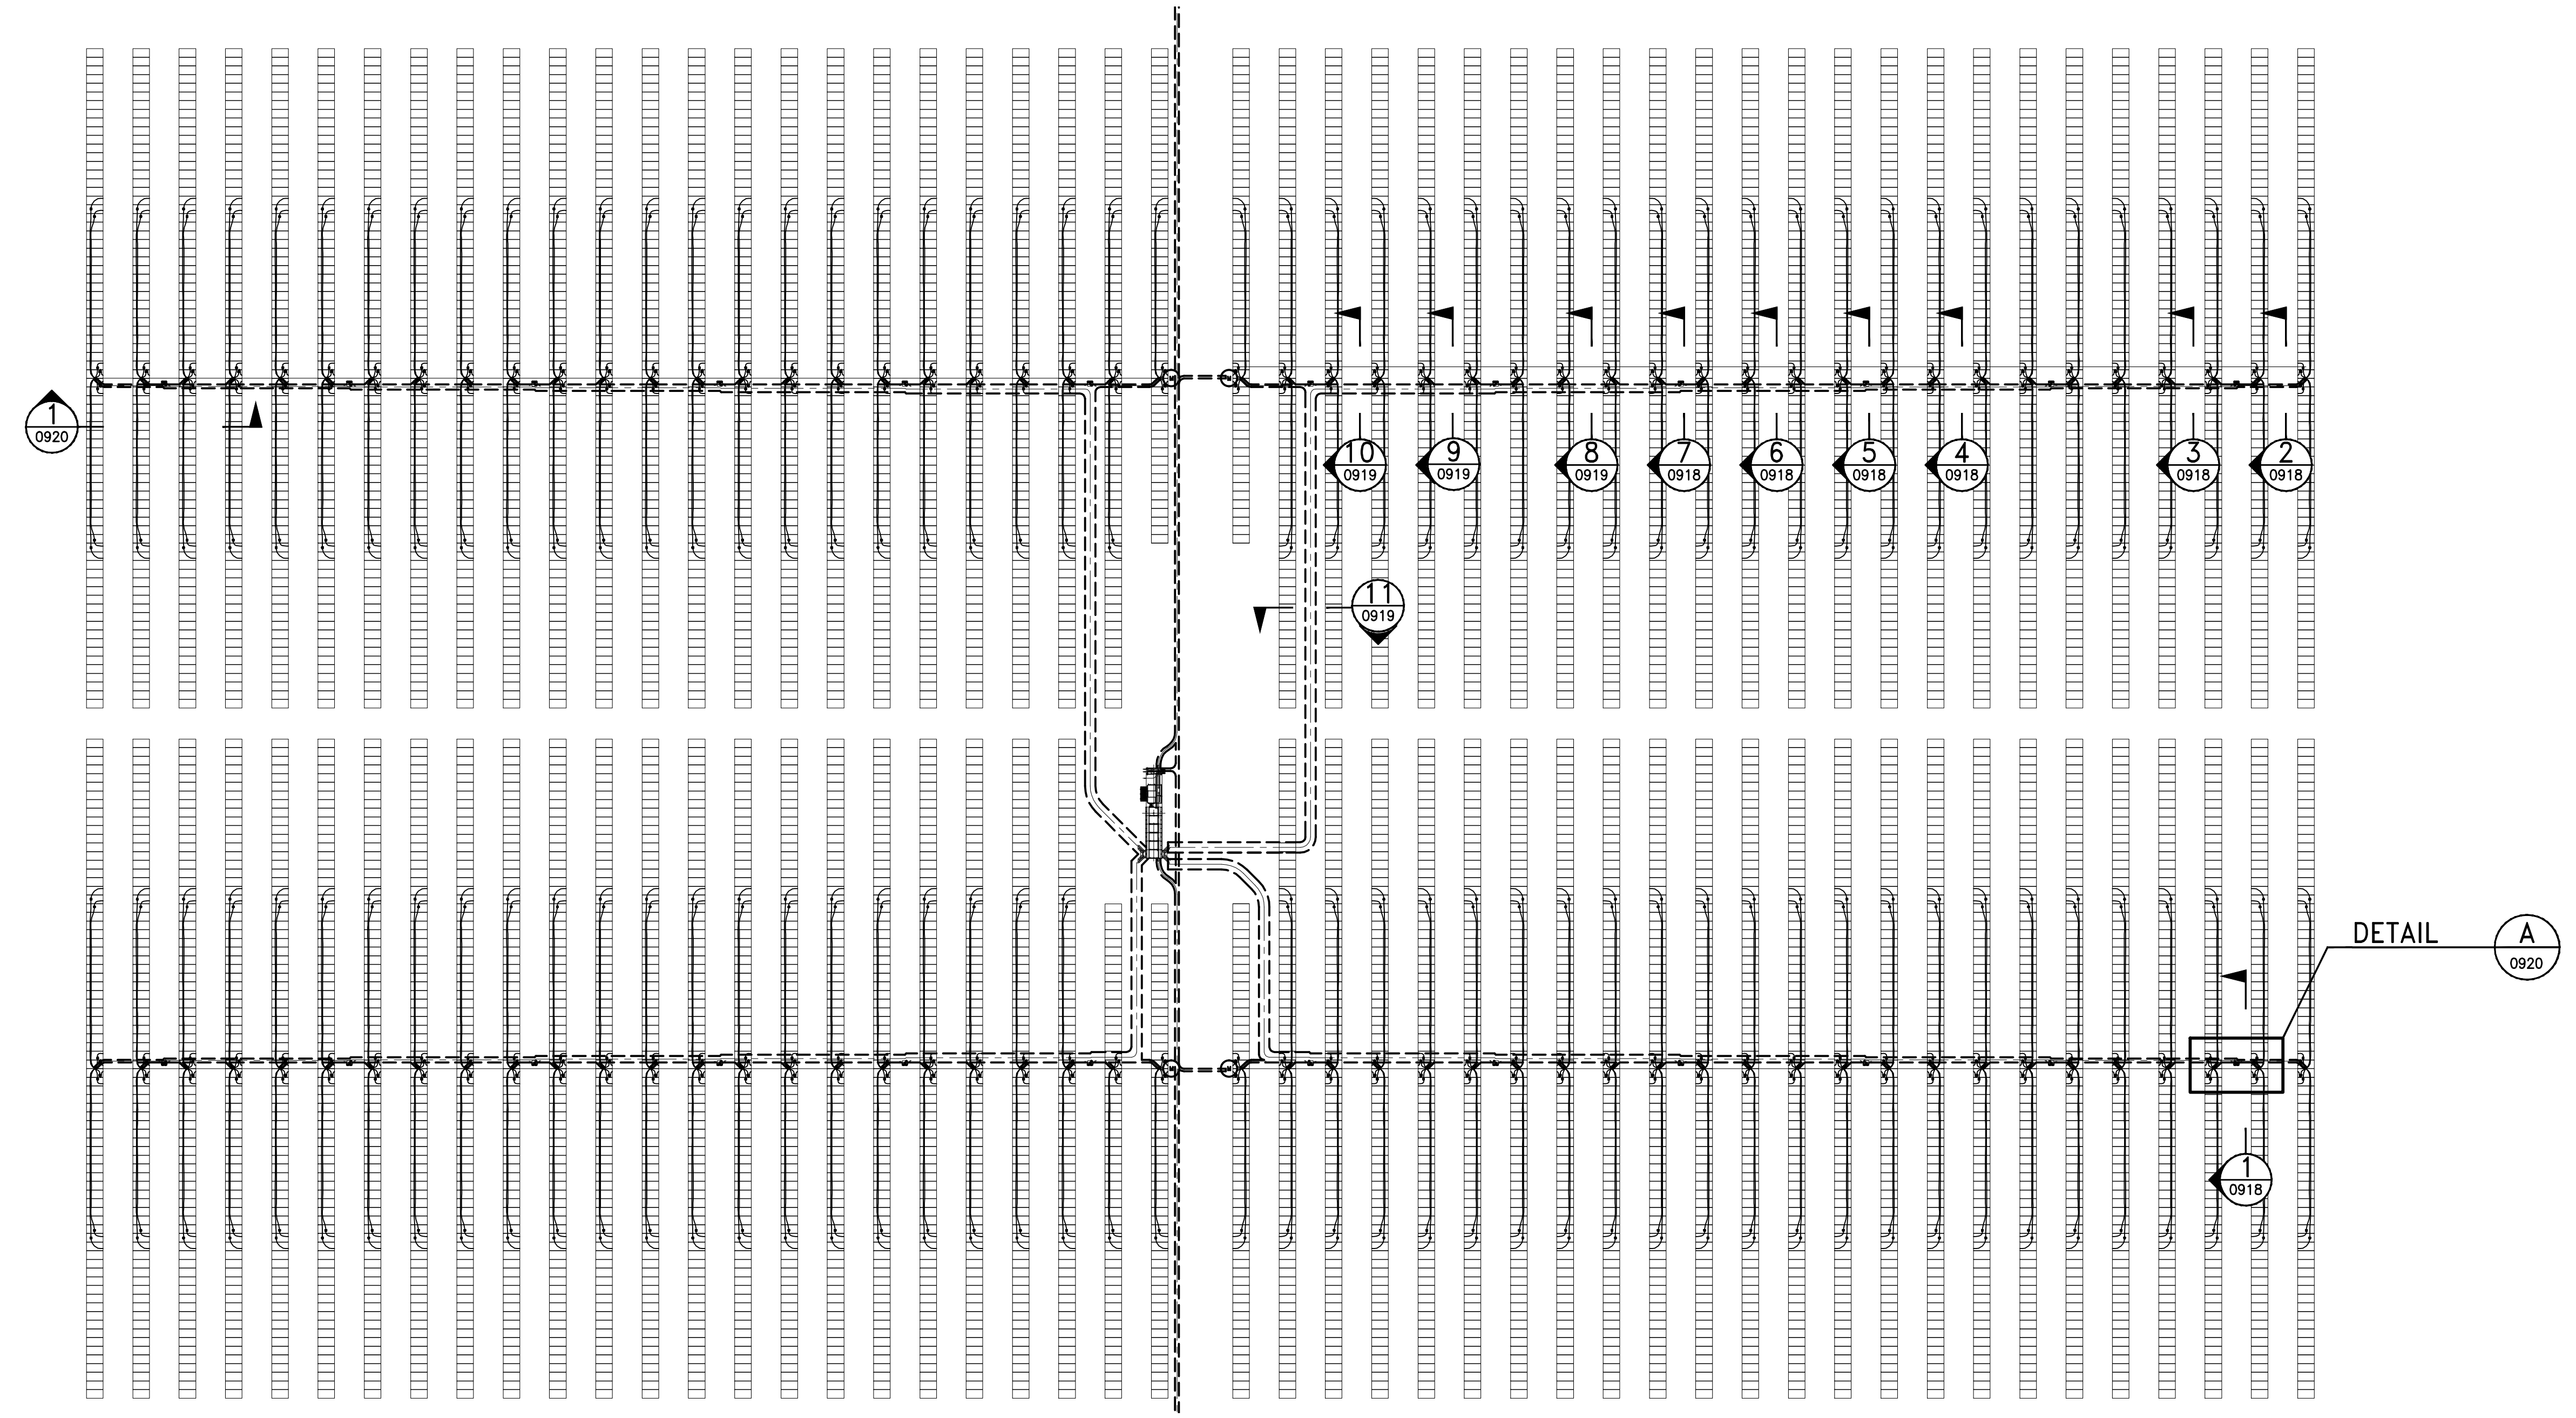

⊙ TRACKER MOTOR
 1.5HP, 460VAC WITH CONTROLLER

WORK SAFELY



UNLESS OTHERWISE AGREED IN A WRITTEN CONTRACT BETWEEN AMEC AND ITS CLIENT: (1) THIS AMEC DOCUMENT CONTAINS INFORMATION, DATA AND DESIGN THAT IS CONFIDENTIAL AND MAY NOT BE COPIED OR DISCLOSED; AND (2) THIS DOCUMENT MAY ONLY BE USED BY THE CLIENT IN THE CONTEXT AND FOR THE EXPRESS PURPOSES FOR WHICH IT HAS BEEN DELIVERED. ANY OTHER USE OR RELIANCE ON THIS DOCUMENT BY ANY THIRD PARTY IS AT THAT PARTY'S SOLE RISK AND RESPONSIBILITY.

APPROVED FOR _____

CLIENT PROJECT MGR. DEPARTMENT MGR. PROJECT MGR.

PROJECT PHASE
 PANOCHÉ VALLEY SOLAR PROJECT

PROJECT NO.	ACTIVITY NO.	DES	BY	DDMMYY
176055		DRN	CAW	09MAY14
SCALE	PACKAGE CODE	CHK	CAD	09MAY14
1"=40'		APP		

SUBJECT
 ELECTRICAL EQUIPMENT LAYOUT
 DC WIRING
 1900KVA TRACKER ARRAY

AREA _____

CLIENT DWG. NO. _____

DRAWING NO.
 D-000-E-0915

REV. B

STAMP/SEAL
CONCEPTUAL DESIGN REVIEW
 NOT FOR CONSTRUCTION

PRELIMINARY

REV	DDMMYY	REVISION / ISSUE DESCRIPTION	DRN	CHK	APP	APP	APP	APP	APP	REV	DDMMYY	REVISION / ISSUE DESCRIPTION	DRN	CHK	APP	APP	APP	APP	REF	NUMBER	TITLE
B	19JUN14	ISSUED FOR CONCEPTUAL DESIGN REVIEW	CAD		CAW					HRM											
A	27MAY14	ISSUED FOR INFORMATION	CAD		CAW					HRM											