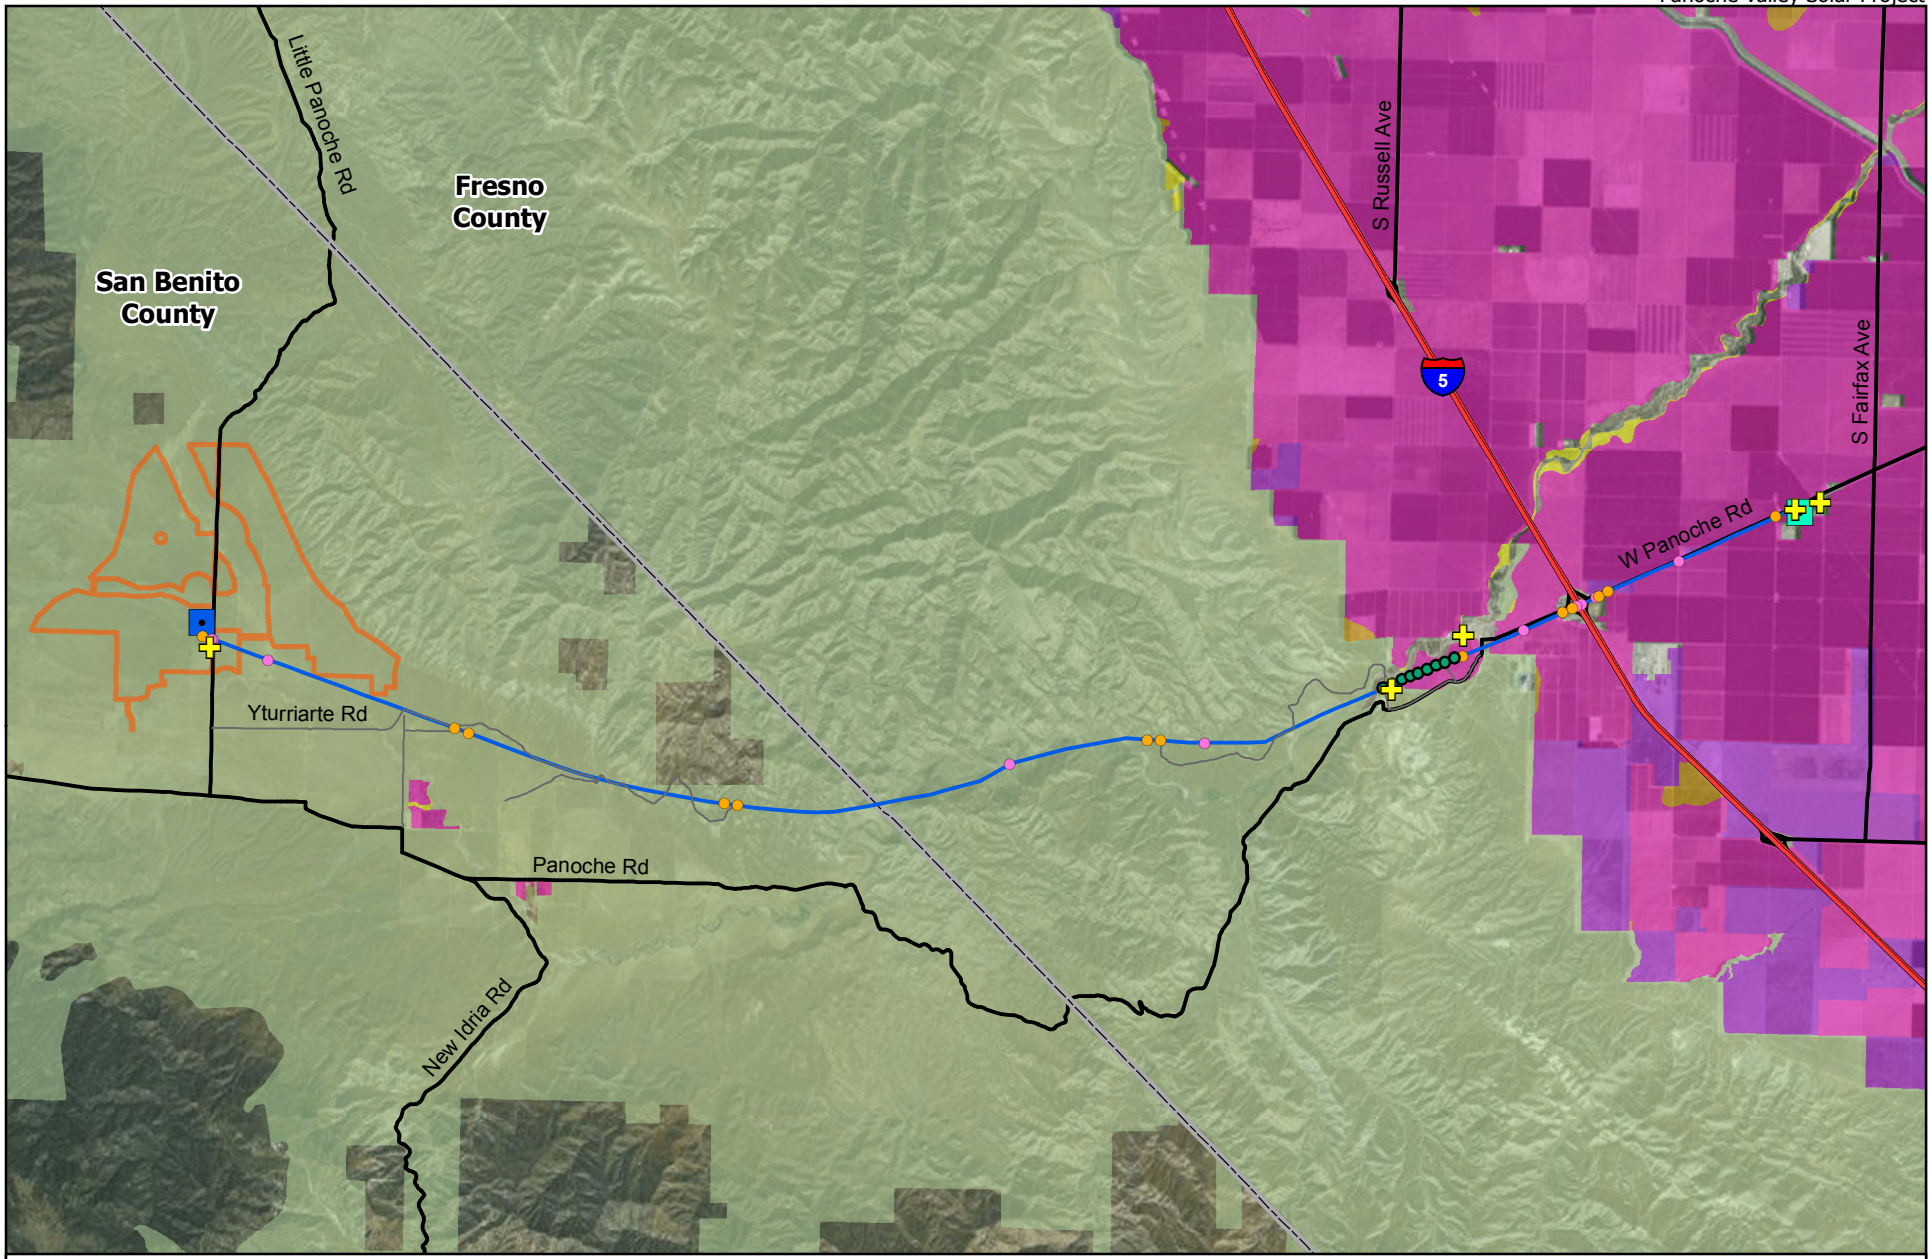

Figure C.3-3

FMMP Designations Near PG&E Upgrades